



## THERMO AQUA 300 HP

ENAMELIRANI SPREMNIK SA JEDNOM SPIRALOM  
ENAMELLED COATED SINGLE COIL HEAT EXCHANGER TANK

ZAPREMININA	BOILER VOLUME	261 LT
RADNI TLAK	OPERATING PRESSURE	10 BAR
TESTNI RADNI TLAK	TEST PRESSURE	13 BAR
POVRŠINA IZMIJENJIVAČA	SERPENTINE SURFACE HEATING AREA	3,175 m <sup>2</sup>
VISINA	HEIGHT	1270 mm
PROMJER	DIAMETER	700 mm
IZOLACIJA	TYPE OF INSULATION	HARD PU / TVRDI PU
DEBLJINA IZOLACIJE	INSULATION THICKNESS	50 mm
GUSTOĆA IZOLACIJE	INSULATION DENSITY	44 kg/m <sup>3</sup>
TEŽINA	WEIGHT	151 kg
KONTROLIRANA KVALITETA	QUALITY CONTROL MADE	

S.P.Sanitarije d.o.o HR-21000 SPLIT  
Ozaljska 1 CROATIA



## PAŽNJA / ATTENTION

### THERMO AQUA 300 HP

ENAMELIRANI SPREMNIK SA JEDNOM SPIRALOM  
ENAMELLED COATED SINGLE COIL HEAT EXCHANGER TANK

**HR** OBAVEZNA UGRADNJA SIGURNOSNOG VENTILA I SMANJIVAČA TLAKA NA ULAZU HLADNE VODE ZBOG ZAŠTITE SPREMNIKA OD PREVISOKOG TLAKA.

**EN** CONNECT 8 ATU SAFETY VALVES AND 6 ATU PRESSURE REGULATORS TO THE COLD WATER INLET TO PROTECT YOUR DEVICE WITH HIGH NET PRESSURE.

**HR** JEDNOM GODIŠNJE ZAMJENITE MAGNEZIJEVU ANODU ZBOG KATODNE ZAŠTITE SPREMNIKA OD KOROZIJE.

**EN** REPLACE THE MAGNESIUM ANODE BAR YEARLY TO PROTECT YOUR DEVICE FROM CATHODIC EFFECTS.


**HR** SPOJITE UZEMLJENJE.

**EN** CONNECT THE EARTH LINE.

KOD NEPOŠTIVANJA GORE  
NAVEDENIH SMJERNICA,  
NE PRIZNAJE SE GARANCIJA  
SPREMNIKA.

IF THE ABOVE WARNINGS  
ARE NOT CONSIDERED,  
YOUR BOILER WILL BE  
OUT OF WARRANTY.

## HEMA INSTALIRANJA SPREMNIKA

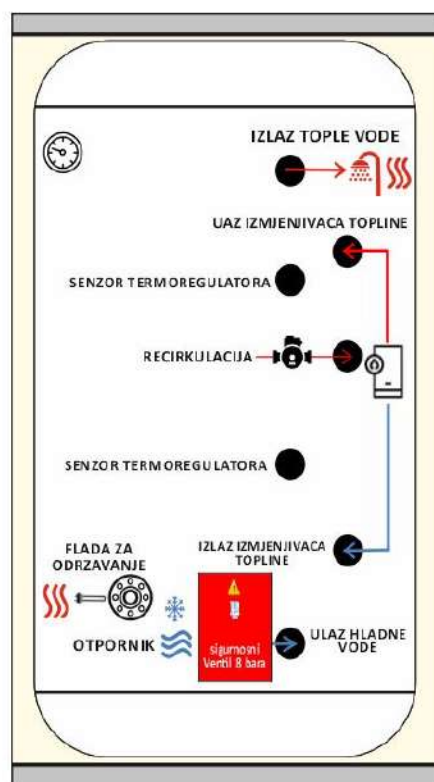

V  
I  
S  
O  
K  
O  
K  
V  
A  
L  
I  
T  
E  
T  
A  
N

S  
P  
R  
E  
M  
N  
I  
K  
V  
O  
D  
E



## THERMO AQUA 200 HP

EMAJIRANI SPREMNIK SA JEDNOM SPIRALOM  
ENAMELLED COATED SINGLE COIL HEAT EXCHANGER TANK

ZAPREMNINA	BOILER VOLUME	200 LT
RADNI TLAK	OPERATING PRESSURE	10 BAR
TESTNI RADNI TLAK	TEST PRESSURE	13 BAR
POVRŠNA IZMJEŃIVAČA	SERPENTINE SURFACE HEATING AREA	2,03 m <sup>2</sup>
VISINA	HEIGHT	2300 mm
PROMJER	DIAMETER	560 mm
IZOLACIJA	TYPE OF INSULATION	HARD PU / TVRDI PU
DEBLJINA IZOLACIJE	INSULATION THICKNESS	50 mm
GUSTOĆA IZOLACIJE	INSULATION DENSITY	41 kg/m <sup>3</sup>
TEŽINA	WEIGHT	80 kg
KONTROLIRANA KVALITETA	QUALITY CONTROL MADE	

S.P.Sanitarije d.o.o HR-21000 SPLIT  
Ozaljska 1 CROATIA



## PAŽNJA / ATTENTION

### THERMO AQUA 200 HP

EMAJIRANI SPREMNIK SA JEDNOM SPIRALOM  
ENAMELLED COATED SINGLE COIL HEAT EXCHANGER TANK

**HR** OBAVEZNA UGRADNJA SIGURNOSNOG VENTILA I SMANJIVAČA TLAKA NA ULAZU HLADNE VODE ZBOG ZAŠTITE SPREMNIKA OD PREVISOKOG TLAKA.

**EN** CONNECT 8 ATU SAFETY VALVES AND 6 ATU PRESSURE REGULATORS TO THE COLD WATER INLET TO PROTECT YOUR DEVICE WITH HIGH NET PRESSURE.

**HR** JEDNOM GODIŠNJE ZAMJENITE MAGNEZIEVU ANODU ZBOG KATODNE ZAŠTITE SPREMNIKA OD KOROZIJE.

**EN** REPLACE THE MAGNESIUM ANODE BAR YEARLY TO PROTECT YOUR DEVICE FROM CATHODIC EFFECTS.

**HR** SPOJITE UZEMLJENJE.

**EN** CONNECT THE EARTH LINE.

KOD NEPOŠTIVANJA GORE  
NAVEDENIH SMJERNICA,  
NE PROIZIJE SE GARANCIJA  
SPREMNIKA.

IF THE ABOVE WARNINGS  
ARE NOT CONSIDERED,  
YOUR BOILER WILL BE  
OUT OF WARRANTY.

## HEMA INSTALIRANJA SPREMNIKA



V  
I  
S  
O  
K  
O  
K  
V  
A  
L  
I  
T  
E  
T  
A  
N

S  
P  
R  
E  
M  
N  
I  
K  
V  
O  
D  
E