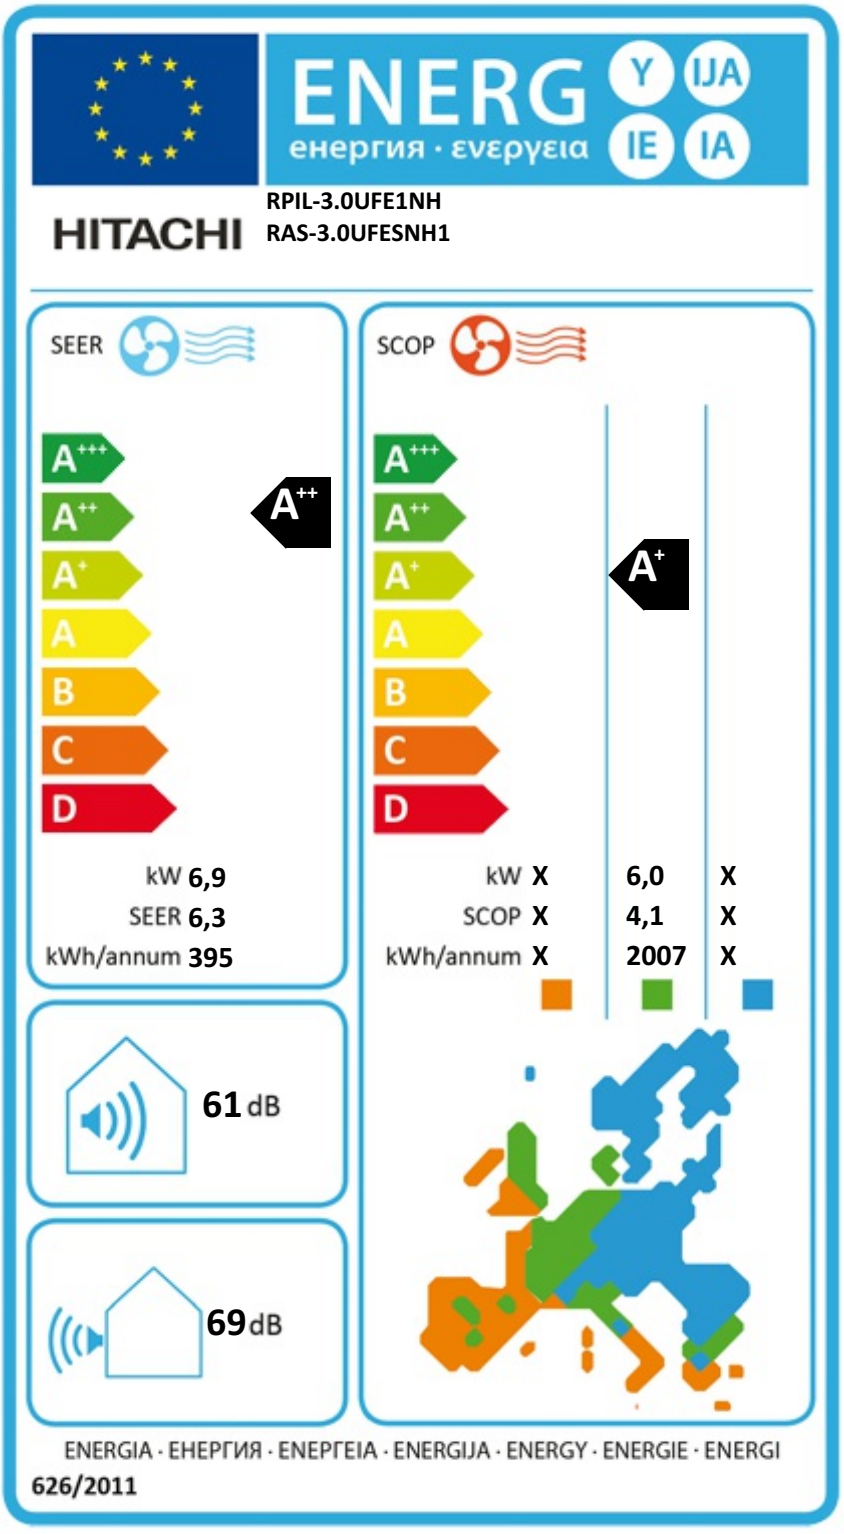
ENERG
енергия · ενεργεια
Y
IJA
IE
IA
HITACHI
RPIL-3.0UFE1NH
RAS-3.0UFESNH1
SEER
A+++
A++
A+
A
B
C
D
A++
kW 6,9
SEER 6,3
kWh/annum 395
SCOP
A+++
A++
A+
A
B
C
D
A+
kW X 6,0 X
SCOP X 4,1 X
kWh/annum X 2007 X
61 dB
69 dB
ENERGIA · ЕНЕРГИЯ · ΕΝΕΡΓΕΙΑ · ENERGIJA · ENERGY · ENERGIE · ENERGI
626/2011

Energy Performance Label

This label is edited by Hitachi's "ErP Active Tool". Ecodesign implementation, in accordance with Annex III of Regulation (EU) No 626/2011 of 4 May 2011, supplementing Directive 2010/30/Eu labeling of equipment air conditioning equipment.

SEER : seasonal performance of the equipment running in cooling mode; The highest is the value,the lowest will be the consumption.Regulation requires for any new product introduced in Europe since 01/01/2013 a minimum value of SEER of 3.6 (D class). D

For more precise information on seasonal performance of the equipment, refer to the values of SCOP and annual consumption (kWh/year).

Indoor Unit sound power level

Outdoor Unit sound power level

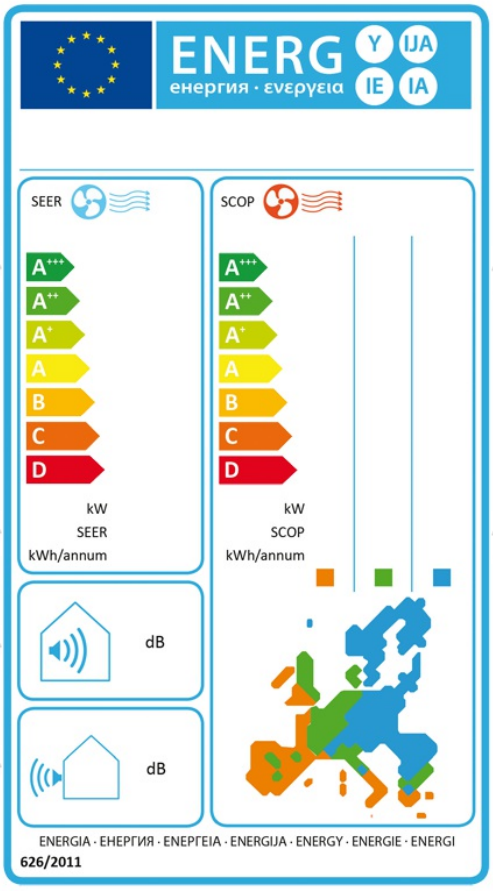

SCOP : seasonal energy performance of the equipment operating in heating mode; The higher is the value, the lowest will be the consumption.Regulation requires for any new product introduced in Europe since 01/01/2013 a minimum value of SCOP on average climate of 3.4 (A class). A

For more precise information on seasonal performance of the equipment, refer to the values of SCOP and annual consumption (kWh/year).

Climates defined by regulation	Lowest outdoor temperature	City used as reference	Heating period (hours/days)
Warm	+2° C	Athene	3590 h / 149 d
Average	-10°C	Strasbourg	4910 h / 204 d
Cold	-22° C	Helsinki	6646 h / 277 d

For heating operation, displayed informations related to the energy consumption are compulsary for average climate. Other climates are optional.